MISO Grid 2033: Preparing for the Transmission Grid of the Future

David E. Dismukes, Ph.D.

Professor & Executive Director
Center for Energy Studies

Professor
Department of Environmental Sciences
College of the Coast and Environment

Final Report
May 7, 2018

Table of Figures

Figure 1: MISO Geographic Footprint 7
Figure 2: MISO Geographic Footprint and Retail Choice 9
Figure 3: MTEP17 Transmission Projects Investment by Category. 14
Figure 4: MTEP17 Top 10 New Transmission Projects. 15
Figure 5: Unconventional Natural Gas Basins and Plays 18
Figure 6: AEO Power Generation Forecast (2005) 19
Figure 7: Natural Gas Production and Reserves 20
Figure 8: AEO Natural Gas Reserves Forecast (2016) 21
Figure 9: Natural Gas Prices and Volatility 22
Figure 10: Annual Net U.S. Electricity Generation by Fuel Type 23
Figure 11: Annual MISO Net Electricity Generation by Fuel Type 24
Figure 12: NERC's Anticipated Natural Gas Capacity for LTRA 2008 through 2016 25
Figure 13: NERC's Anticipated Coal Capacity for LTRA 2008 through 2016 25
Figure 14: Annual Natural Gas Fired Capacity Additions, MISO Only 26
Figure 15: Annual Natural Gas Fired Capacity Additions, U.S. 27
Figure 16: Spot market electricity prices (on peak) 28
Figure 17: Spot market clearing heat rates (on-peak) 29
Figure 18: Annual Wind Capacity Development, U.S. and MISO 30
Figure 19: Potential MISO Wind Capacity Development (2018) 31
Figure 20: U.S. Grid-Connected Solar Capacity Development (2018) 32
Figure 21: MISO Proposed Grid-Connected Solar Capacity Development (2018) 33
Figure 22: State Renewable Portfolio Standards (2018) 35
Figure 23: State RPS Compliance by 2035 36
Figure 24: Wind Energy Capacity Development (1980-2017) 37
Figure 25: Corporate Off-site renewable energy purchases (2010-2016) 39
Figure 26: Terrestrial Wind Generation Installed Capital Costs (2010-2016) 41
Figure 27: MISO Generation Fuel Mix (2010, 2016 and 2020) 46
Figure 28: U.S. Net Metering Capacity Growth (2013-2017) 48
Figure 29: Trends in Installed Solar Generation Costs (2010-2017) 50
Figure 30: Forecast U.S. Solar Capacity by Market Segment (2015-2020) 53
Figure 31: MISO-Based Projection, Solar Capacity by Market Segment (2016-2020) 54
Figure 32: U.S. Estimated Electricity Rates (Retail Revenue cents per kWh) 58
Figure 33: MISO "All-In" Wholesale Electricity Price vs. Natural Gas Price 65
Figure 34: MISO Real-Time Energy Price-Duration Curve (2014-2016) 66
Figure 35: Comparison of RTO Pricing Volatility 67
Figure 36: MISO Real Time Congestion Value (2014-2016) 68
FiTw 12 -0 0 -1 2 7 (2 0 4 T w (0 - 3 4 (2 0 1) 2 0 1 6)] T J a S i g u r e 3 6 : M I S O R e a l T i m e C o n g e s t i o n V a l u e (2 0 1 4 - 2 0 1 6) 6 8 T d n (2 0 1 6) 2 0

Table of Tables

Table 1: MTEP17 Transmission Investments 16
Table 2: Historic Annual MTEP Transmission Investments 16
Table 3: MTEP17 Annual Transmission Investment by Year and Voltage 17
Table 4: Large Transmission Infrastructure Projects 34
Table 5: U.S. and MISO Coal Generation Retirements (2011-2016) 44
Table 6: Projected U.S. and MISO Coal Generation Retirements (2018-2025) 44
Table 7: Announced and Anticipated Nuclear Generation Retirements 45
Table 8: MISO Solar Capacity (2012-2016) 51
Table 9: MISO Solar NEM Capacity (2012-2016) 52
Table 10: MISO Solar Interconnection Requests 55
Table 11: Net Transmission and Distribution Plant in Service per Customer (MISO IOUs) 59

Executive Summary

The bulk power system arose over the past century to h5 EMC24 (entesy)4 (s)4 (t)22 (heecs

run MISO transmission infrastructure planning. The MISO 2033 event highlighted the irony that, while the development of physical capacity is becoming increasingly more challenging and important, the traditional means of valuating this capacity is coming under assault leading to what can be thought of as a “post-capacity” world.

The antecedents of this post-capacity world are varied. Capacity, both physically and as an economic commodity, has become increasingly devalued by: the deteriorating value in traditional baseload resources (i.e., coal and nuclear); the rise of just-in-time natural gas fired generation; the plethora of zero-marginal cost renewable resources at the bulk power system level (primarily wind); the emergence of distributed generation (mostly solar) and other demand-side resources; and various state and federal policy actions over the past decade. At the same time, electricity customers are becoming increasingly restless as they are being called upon to financially support, through higher rates, the investments (including transmission investments) needed to support these increasingly complicated industry changes. This is forcing some customers to look for ways to potentially bypass the entire system through what they see as more empowering alternatives such as distributed generation and efficiency creating a potential feed-back effect that, if not managed correctly, could itself have even further negative implications for the addition of new transmission capacity and infrastructure.

A consistent public policy theme in U.S. politics is developing and rebuilding infrastructure. The discussion at the MISO 2033 event echoed many of the same themes of urgency and necessity for transmission infrastructure development that are echoed in discussions about upgrading roads, highways, schools, hospitals, transportation, communications and water systems. However, the voices of inertia and the status quo

are often heralded as the main barriers to boldness and vision and often the only factor that unfortunately seems to break the logjam between these two opposing forces are large-scale infrastructure failures and catastrophes. The bulk power transmission system is no stranger to this phenomenon as witnessed by numerous large-scale power outages that have occurred since the infamous northeastern black out of 1965. Clearly, this is no way to manage, much less plan for a highly complicated set of critical energy infrastructure.

Technology, in particular, seems to be placing some of the more significant and near-term challenges on transmission system investments. This should come as no

system reliability important during transition periods like the one currently being witnessed in the industry.

The other pressure point for an organization like MISO, in developing the transmission infrastructure requirements of tomorrow, is understanding what tomorrow's customers want and need. What appears to be increasingly apparent is that customers want more choices: customers want to be able to choose across a variety of environmental attributes; they want to be able choose across a variety of price and service offerings; they want to be able to choose across a variety of different service providers and, increasingly, they want this flexibility provided within a system that is clean, reliable and resilient and one that minimizes costs and maximizes end-user value.

Once again, the MISO 2033 event found that these perceived conflicts are not mutually exclusive and, in fact, can be accommodated within a broad vision for transmission infrastructure development. MISO's transmission planning efforts will likely facilitate these consumer empowerment issues by:

- Integrating new technologies into a larger footprint that facilitates a wide range of customer choices.
- Developing new physical infrastructure investments to strengthen existing

1. Introduction

In November 2017,

increasingly complicated industry changes. This is forcing some customers to look for ways to potentially bypass the entire system through what they see as more empowering alternatives such as distributed generation and efficiency, creating a potential feed-back loop that, if not managed correctly, could itself have even further negative implications for the development of new capacity.

The changing nature of the power industry, its stakeholder impact, and how to plan for a transmission system of the future are all issues that played directly into the theme of the two-day MISO 2033 event. A wide range of stakeholders, representing the expansive MISO geographic footprint, participated in the MISO 2033 event including regulators, aca -0.02 Tc 0.oisuesndustryntl feesaren20 (t)2 (.)2 ((i)-13.9 6(es)4 (s)24 ac)4 (t)22 (or

planning staff and stakeholders. MISO's transmission planning process considers a variety of considerations that include

MISO is also unique in its regulatory composition. MISO, unlike other RTOs in New England and the Mid-Atlantic, are dominated by vertically integrated IOUs that are in non-retail choice states (see Figure 2). The heavy concentration of traditional, vertically-integrated power markets makes the political economy of emerging empowerment issues, such as limited industrial choice, or increasing distributed generation, different than say, New England or the Mid-Atlantic. It also raises a host of issues for a part of the country where regulators tend to place a very high priority on promoting economic development.

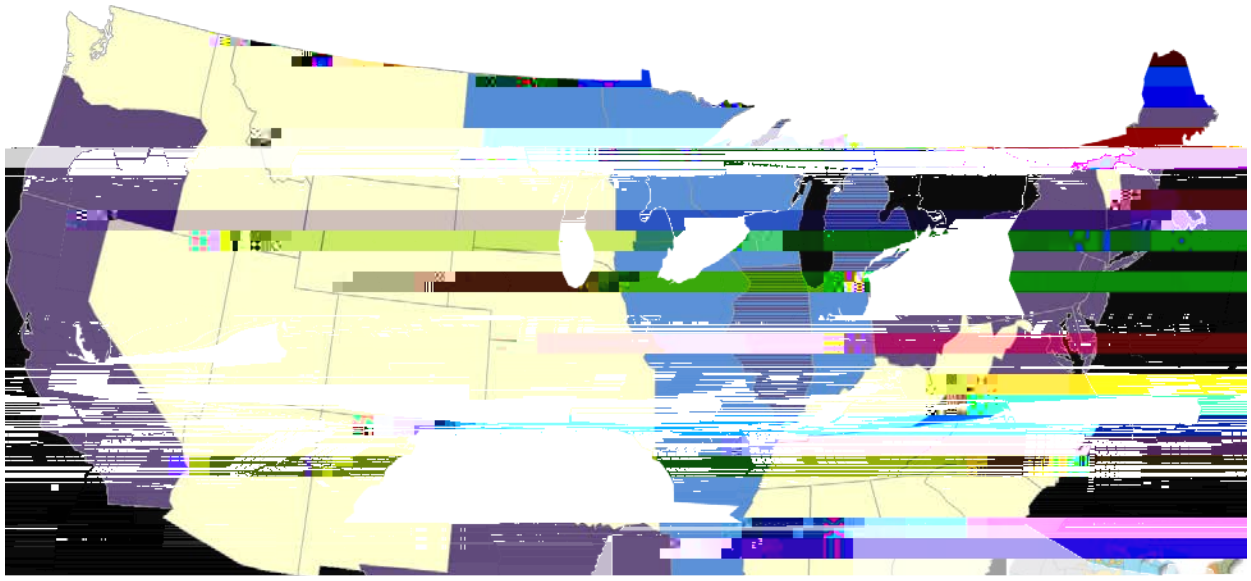

Figure 2: MISO Geographic Footprint and Retail Choice
Source: Author's construct using sources from MISO; U.S. Energy Information Administration; and FERC.

c. Diversity versus Flexibility

Infrastructure planning and development in the electric power industry can be an exceptionally rigid process: it takes talent and creativity to build flexibility into the process.

advocate for an expanded number of infrastructure planning outcomes that go beyond simple economics (i.e., least cost outcomes) and include those that are more "environmentally neutral," are more "reliable," result in greater power "quality," or lead to more "robust" or "resilient" systems. Contrary to expectations, it could very well be the case that these expanded number of transmission planning considerations will actually lead to an increase, and not a decrease in risk given the additional variability that each new consideration places on the planning process.

d. The Role of Communication and Education

Another major theme throughout the MISO 2033 event was the importance of active stakeholder communication and education, developed through a transparent and accountable process. Each of these concepts (communication, education, transparency, and accountability) has differing meanings and implications for longer-run transmission infrastructure investment and planning.

Communication is the vehicle by which stakeholder interests are conveyed to MISO and serves as the primary feedback mechanism by which the effectiveness of a proposed longer-term transmission infrastructure plan is anticipated to meet stakeholder needs and expectations.

Education, on the other hand, is the process by which MISO makes all of its stakeholders aware of its transmission infrastructure planning goals, resources, and constraints. Education is also the means by which MISO explains the types of challenges it is currently facing, the nature and characteristics of those challenges, and how its proposed transmission plans are designed to address these challenges and mitigate their potentially negative impacts.

Transparency was an equally important topic discussed at the MISO 2033 event. Many stakeholder participants expressed the view that transparency was vital to the longer-run MISO transmission planning process. Transparency assures that all stakeholders are aware of all information, assumptions and data used in the planning process, including all of the non-selected transmission plan alternatives. Transparency is critical in order to ensure the integrity of the transmission planning process, particularly with many non-member stakeholders, who may often feel like they are on the outside, looking in, such as customer groups and state regulators.

Accountability is an equally important concept that was discussed at the MISO 2033 event. Transmission infrastructure planning and development requires a considerable degree of financial capital, and that capital does not come for free. While MISO directly answers to its members, those same members usually, at some point, answer to a customer, or a set of state regulators that represent and protect customer interests. All of these interests are served by comparing past plans to current actions and outcomes to assure results and, to explain deviations from results where possible and how those deviations, particularly if they result in negative outcomes, can be avoided in the future.

e. MISO's Recent Regional Investment Trends and Value Creation

Each year, MISO conducts a transmission planning process that focuses on maximizing value to members while minimizing the total energy, capacity and transmission costs of the MISO system. As part of this process, MISO identifies essential transmission projects that will improve the reliability and efficiency of energy delivery in the region over a ten-year period. This 18-month collaborative process between MISO

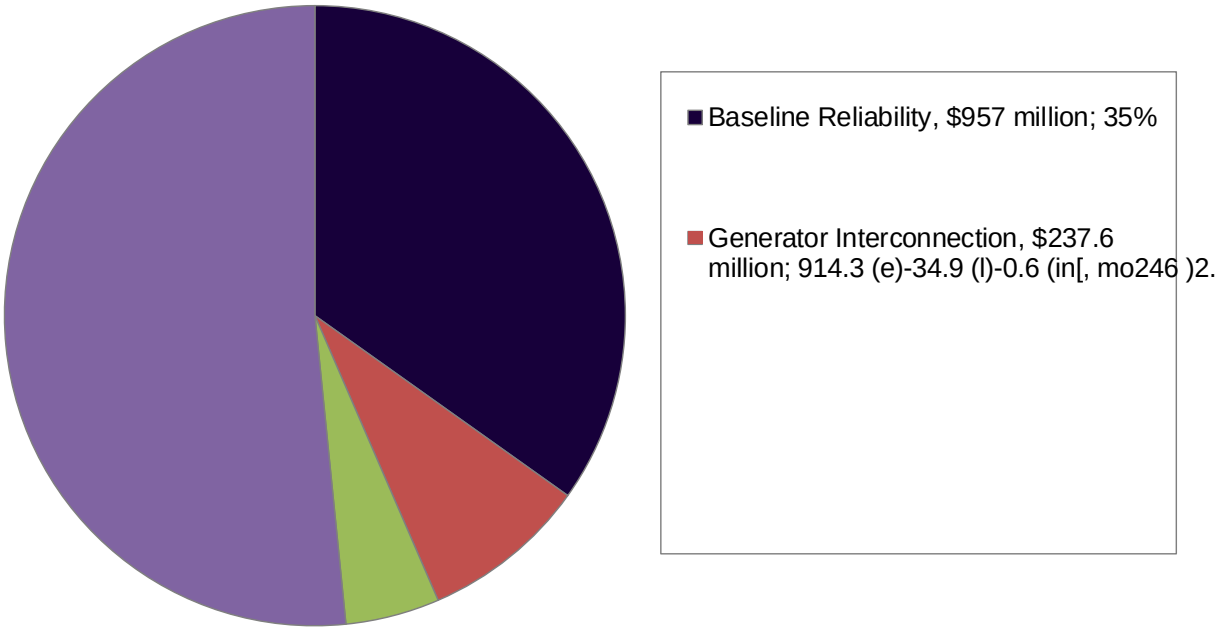

Figure 3: MTEP17 Transmission Projects Investment by Category.
Source: MISO, MTEP17.

Figure 4 shows that the largest 10 projects proposed in MTEP17 represent $756 million in total investment or 28 percent of total costs. A large share of the MTEP17 projects (eight of the ten) are in the MISO South region including the top four investments.

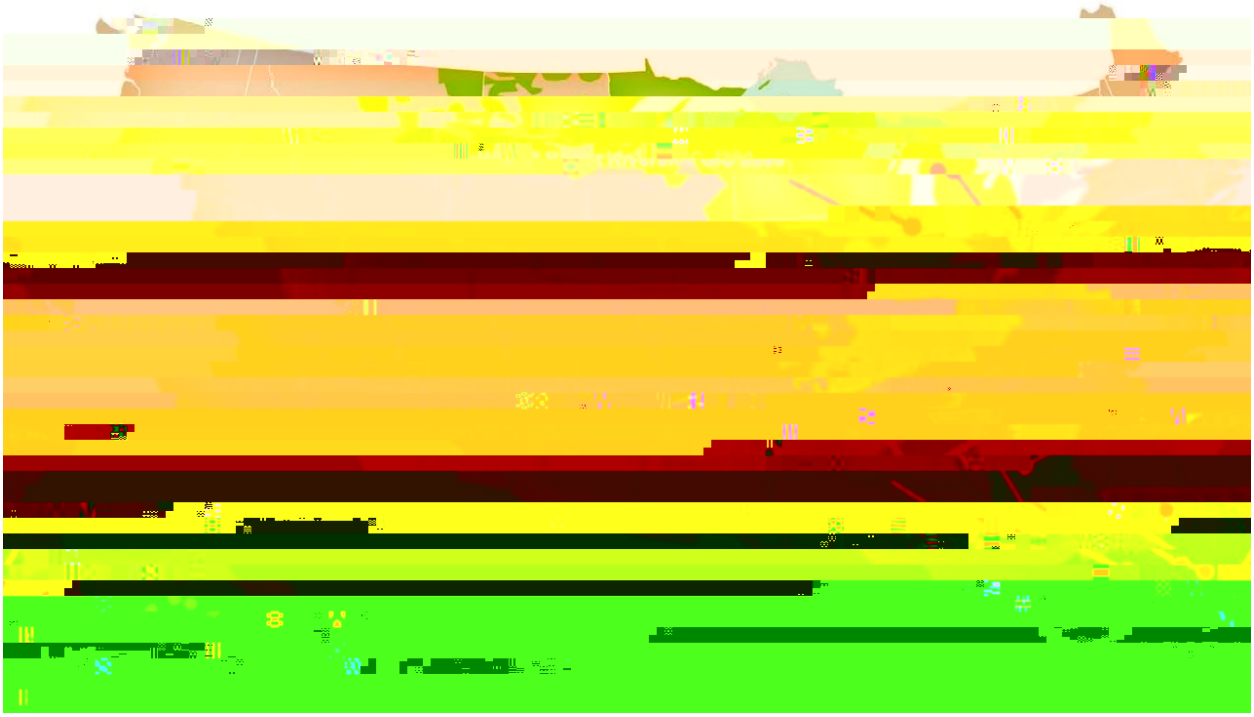

Figure 4: MTEP17 Top 10 New Transmission Projects.
Source: MISO, MTEP17.

Table 1 presents a breakdown in proposed MTEP17 transmission investment. Nearly $1.8 billion of the $2.7 billion in total transmission investment (46.5 percent) is associated with investments in the MISO South region and represents MISO's continued efforts to improve the region's transmission capabilities as represented by the $772.5 million in baseline reliability projects investments.

Table 1: MTEP17 Transmission Investments

MISO	Baseline Reliability	Generator Interconnection	Market Efficiency	Other	Total
			(million $)		
$ 320.8	$ 386.2	Central	$ 65.4		
$ 341.4	$ 411.9	East	$ 53.2	$ 12.4	$ 4.9
$ 343.6	$ 1,277.2	South	$ 772.5	$ 31.4	$ 129.7
$ 65.8	$ 193.8	West	$ 410.9	$ 670.6	
$ 957.0	$ 237.6	$ 134.6	$ 1,416.7	$ 2,745.9	Total

Source: MISO, MTEP17.

Table 2 presents MISO's historic transmission investment trends from 2000 (MTEP7) to current (2017; MTEP17) highlighting that the current annual transmission level of $2.7 billion is consistent with the last four-year trends, despite the recent addition of the MISO-South region.

Table 2: Historic Annual MTEP Transmission Investments

	Baseline Reliability Project	Generator Interconnection Project	Market Efficiency	Other	Total
		(million $)			
MTEP7	$ 691.6	$ 293.9	$ -	$ -	$ 985.5
MTEP8	92.2	46.6			138.8
12.9	-	-	1,251.2	1,238.3	MTEP8
64.6	5.6	-	241.0	170.8	MTEP9
2.1	-	510.0	566.4	43.3	MTEP10
12.9	-	1,008.1	4,797.6	384.3	MTEP11
		4.0		4.0	MTEP13
269.5	38.8		2,310.2	2,618.5	MTEP14
1,294.3	75.6	6.4	1,380.6	2,748.8	MTEP15
691.2	142.8	108.0	1,747.5	2,689.5	MTEP16
MTEP17	$ 3,037.3	$ 2,931.3	$ 1,416.7	$ 4,745.9	$ 12,131.2

Source: MISO, MTEP.

reserves development, which can be thought of as the longer-run inventory of natural gas from which future production can be pulled, also increased dramatically during this time.

Figure 7: Natural Gas Production and Reserves
Source: U.S. Energy Information Administration.

The forecast for continued natural gas supply growth, in terms of reserve/resource additions, continues to be positive and the debates about the sustainability of the resource base are becoming less frequent. Figure 8 shows the most recent EIA forecast for U.S. natural gas reserves that are anticipated to grow to over 340 trillion cubic feet ("TCF") by 2040. These estimates, however, are conservative relative to some estimates that have reserves/resource potentials growing to as large as 631 TCF (MIT Energy Institute), or 900 TCF (ITG Investment Research) or even as high as 2,750 TCF (IHS Energy).

Figure 8: AEO Natural Gas Reserves Forecast (2016)
Source: U.S. Energy Information Administration.

The most significant game changer arising from the new supplies of unconventional natural gas are the impacts these supplies have had on the level and volatility of natural gas commodity prices. Figure 9 presents the historic trends in natural gas prices over the past three decades. In the "pre-crisis" natural gas era (before 2001), natural gas prices averaged $2.89 per MMBtu with a variation, or volatility of about $1.46 per MMBtu. Natural gas prices spiked during the winter of 2000-2001 and generally remained high up to the financial crisis of 2008-2009. During this crisis period, natural gas prices annually averaged $6.24 per MMBtu – some monthly and daily peaks, however, were considerably higher during this time. Annual average natural gas price volatility during this time was also extremely high, at $2.39 per MMBtu.

Figure 9: Natural Gas Prices and Volatility
Source: U.S. Energy Information Administration.

Prices and price volatility have fallen considerably in the shale era. Natural gas prices have averaged $3.47 per MMBtu since 2008 and, more importantly, natural gas price volatility has fallen to an annual average of $0.90 per MMBtu. This low price/low price volatility has dramatically impacted power generation since today, natural gas fired generation is quick to plan, develop and install, and very affordable to dispatch on a marginal cost basis.

The development of these resources, and the lack of volatility associated with its pricing has also contributed, in its own way, to the paradox of decreasing capacity value in today's market. The "just-ini n

relatively quickly and is dispatched at low marginal costs that is competitive with even solid fuels, helps to support this trend unwinding capacity value in today's energy markets.

4. Natural gas is dramatically changing power generation fuel mixes

Low natural gas prices have dramatically changed U.S. power generation,

that predominance has deteriorated since 2013. Today, even in MISO, natural gas fired generation is at least on par with coal in terms of its use as a generation energy source, and holds a market share that is comparable, if still slightly lower, than the overall U.S. average.

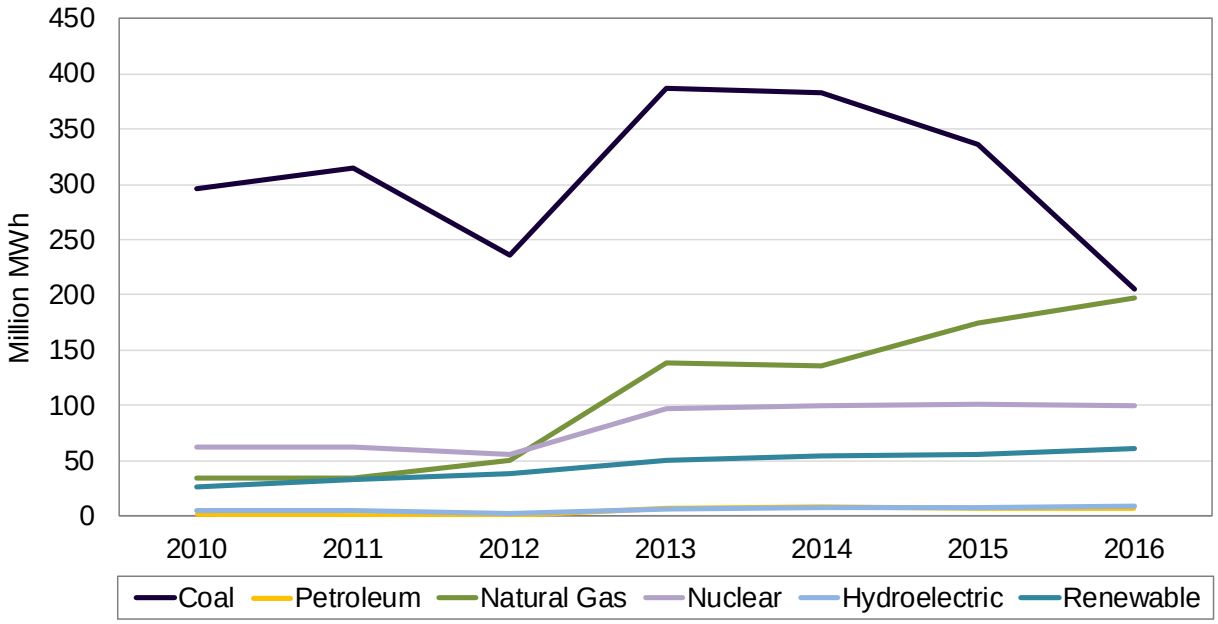

Figure 11: Annual MISO Net Electricity Generation by Fuel Type
Source: U.S. Energy Information Administration.

The National Electric Reliability Council ("NERC") expects the trend in replacing coal-fired generation capacity with natural gas fired generation capacity to continue across North America. Indeed, NERC has been accelerating its projections on the growth on natural gas generation capacity in recent years. Figure 12 presents NERC's forecasted electric generation capacity from natural gas for each NERC forecasted Long-Term Resource Assessment ("LTRA"), 2008 through 2016. Likewise, Figure 13 presents NERC's forecasted electric generation capacity from coal-fired generation capacity across North America.

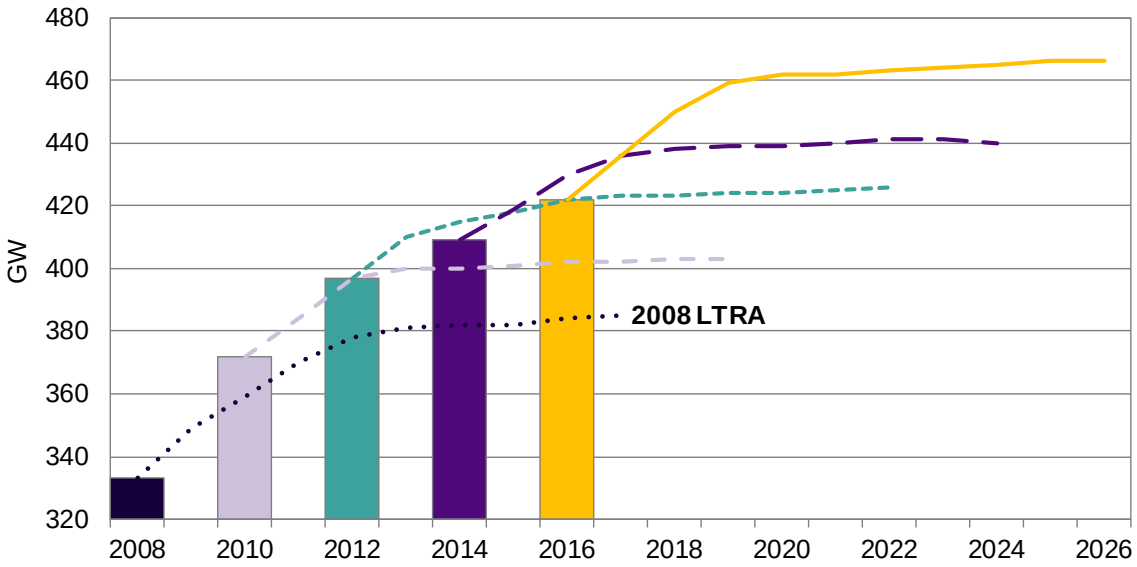

Figure 12: NERC's Anticipated Natural Gas Capacity for LTRA 2008 through 2016
Source: NERC, Long-Term Reliability Assessment.

Figure 13: NERC's Anticipated Coal Capacity for LTRA 2008 through 2016
Source: NERC, Long-Term Reliability Assessment.

5. Natural gas is partially responsible for undermining the traditional capacity-value model

Natural gas generation has also, perhaps unwittingly, contributed to the undermining of capacity value of just about any type in regional U.S. power markets. The origins of this deterioration pre-date the shale revolution, and date back to the late 1990s when over 200,000 MW of natural gas fired generation were added. Even in a region like MISO, which has a long and extensive history with solid fuel generation, there were considerable levels of natural gas fired capacity additions. Figure 14 and Figure 15 present the annual gas fired capacity additions for MISO, and the U.S. overall.

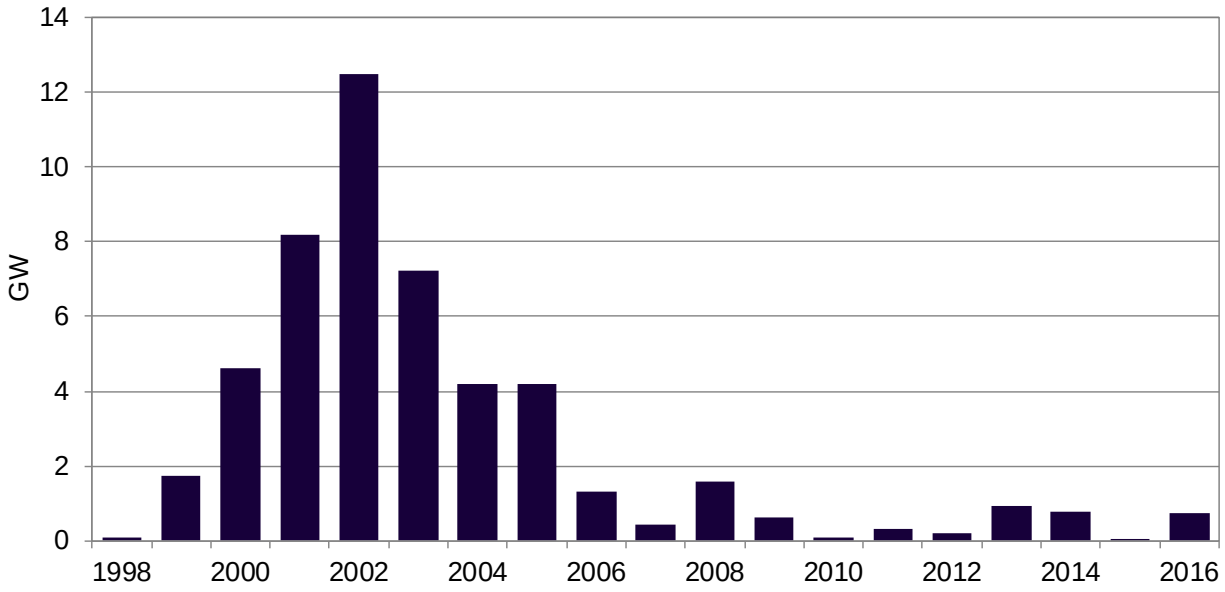

Figure 14: Annual Natural Gas Fired Capacity Additions, MISO Only
Source: U.S. Energy Information Administration.

Figure 15: Annual Natural Gas Fired Capacity Additions, U.S.
Source: U.S. Energy Information Administration.

These capacity additions led to the rapid overcapitalization of most generation markets particularly those that were in, or have become part of

Figure 16:

Figure 17: Spot market clearing heat rates (on-peak)
Source: U.S.



Figure 18: Annual Wind Capacity Development, U.S. and MISO
Source: U.S. Energy Information Administration.

In 2010, MISO-based wind capacity amounted to 8,104 MW. By the end of 2016, this capacity had increased by almost double, to 15,823 MW. The MISO 2033 event clearly noted that this development likely to continue to be considerable. Figure 19, shows that the current MISO interconnection queue has over 22.1 GW of wind capacity requesting to be developed in the MISO footprint over the next three years.

Figure 19: Potential MISO Wind Capacity Development (2018)
Source: MISO Interconnection Queue.

Even more impressive is the amount of solar energy that has been developed throughout the U.S. and in the MISO footprint. Figure

Figure 20: U.S. Grid-Connected Solar Capacity Development (2018)
Note: Chart does not draw MISO installed solar capacity to scale for illustrative purposes.
Source: U.S. Energy Information Administration.

Equal

expressly developed to connect often remote RE installations to more populated load-serving areas.

Table 4: Large Transmission Infrastructure Projects

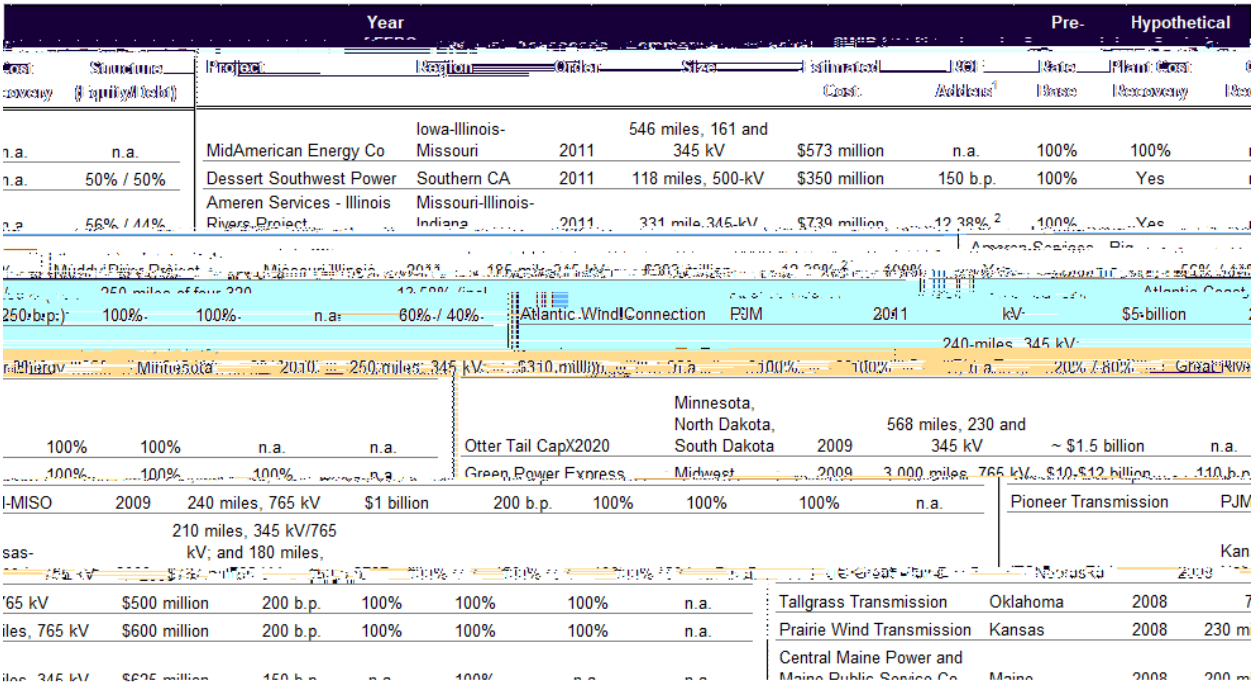

Year	Project	Region	Order	Size	Estimated Cost	ROE Adders[1]	Pre-Vote Base	Hypothetical Plant Cost Recovery
n.a.	MidAmerican Energy Co	Iowa-Illinois-Missouri	2011	546 miles, 161 and 345 kV	$573 million	n.a.	100%	100%
n.a.	Dessert Southwest Power	Southern CA	2011	118 miles, 500-kV	$350 million	150 b.p.	100%	Yes
n.a.	Ameren Services - Illinois Rivers Project	Missouri-Illinois-Indiana	2011	331 mile 345-kV	$739 million	12.38%[2]	100%	Yes
250 b.p.)	100%	100%	n.a.	60% / 40%	Atlantic Wind Connection	PJM	2011	kV	$5 billion
		Minnesota	2010	250 miles, 345 kV	$310 million	n.a.	100%	100%
100%	100%	n.a.	n.a.		Otter Tail CapX2020	Minnesota, North Dakota, South Dakota	2009	568 miles, 230 and 345 kV	~ $1.5 billion	n.a.
100%	100%	100%	n.a.		Green Power Express	Midwest	2009	3,000 miles, 765 kV	$10-$12 billion	110 b.p.
I-MISO	2009	240 miles, 765 kV	$1 billion	200 b.p.	100%	100%	100%	n.a.	Pioneer Transmission	PJM
sas-		210 miles, 345 kV/765 kV; and 180 miles,								Kan
'65 kV	$500 million	200 b.p.	100%	100%	100%	n.a.	Tallgrass Transmission	Oklahoma	2008	7
iles, 765 kV	$600 million	200 b.p.	100%	100%	100%	n.a.	Prairie Wind Transmission	Kansas	2008	230 m
							Central Maine Power and			

Note: [1]In most cases a specific ROE will be determined when the project makes future filings under FPA section 205 (updating revenue requirement to reflect the fact that the facilities have been placed in service); [2]Ameren did not seek a stand-alone incentive ROE adder
Source: Federal Energy Regulatory Commission; and [3]Two of the eight segments in Pacificorp's Energy Gateway Transmission Expansion Project will connecting transmission-constrained wind resources in Wyoming to westward load centers. The cost reported here pertains to these two segments only.
Source: Federal Energy Regulatory Commission.

b. RE development motivators

There are several reasons for the explosion in RE capacity development over the past several years. Perhaps the most significant stimulus for RE development rests with a variety of public policies, mostly financial support mechanisms that support RE, or actively encourage RE development. Stakeholders participating in the MISO 2033 event activity discussed the important, and yet changing role of public policy in RE support.

Perhaps the most pervasive public policy supporting RE development rests with the widespread utilization of state-level renewable portfolio standards ("RPS"). Figure 22 outlines the number of states with an active RPS and the currently-anticipated terminal RE generation shares mandated by state regulations or legislation. Several of these states, such as Minnesota, Illinois, Missouri and Michigan are within the MISO footprint. RPS policies effectively set a RE capacity development floor and support the anticipated RE capacity development levels discussed earlier.



Figure 22: State Renewable Portfolio Standards (2018)
Source: U.S. Energy Information Administration.

Full compliance with these RPS requirements alone will result in a considerable amount of RE being put to the grid by 2035. Figure 23 provides the total renewable capacity and percent of retail sales, in rank order, associated with each state's RPS. MISO states are highlighted in a lighter color. In total, the U.S. is anticipated to add 90.6

GW of capacity, totaling 17.6 percent of all retail sales by 2035. MISO states are anticipated to add 17.9 GW, summing to 8 percent of all retail sales, by the same date.

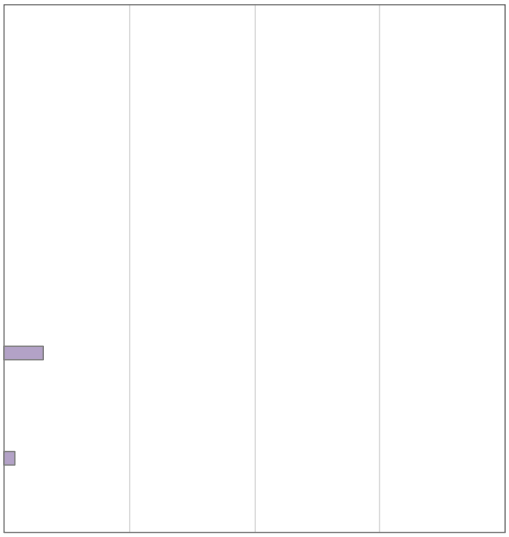

Figure 23: State RPS Compliance by 2035
Source: U.S. Energy Information Administration, Author's construct.

Tax incentives are another form of public policy support that has considerably impacted RE development, for both large scale grid-connected projects, as well as smaller-scale behind-the-meter applications. Perhaps one of the most important, and penultimate tax incentive policies supporting RE development has been the production tax credit ("PTC") which was created as part of the Energy Policy Act of 1992 and provides a per-kWh financial credit for RE power generation from qualifying facilities. This credit has been allowed to expired, and yet later resuscitated several times since 1992 and while its various incarnations have been applicable to several RE resources, the PTC is commonly held as being responsible for stimulating a large amount of wind energy development throughout the U.S. as seen in Figure 24.

Figure 24: Wind Energy Capacity Development (1980-2017)
Source: U.S. Energy Information Administration, Author's construct.

During the MISO 2033 event, a number of stakeholders noted that corporate attitudes towards RE were changing and that this would likely put further pressure on the transmission planning process since it would result in: (a) ever increasing RE capacity development and its inherent challenges and (b) a possibility that some of this RE capacity development would increasingly be co-located at larger industrial facilities that may require additional transmission infrastructure in order to serve. Many stakeholders, including industrial stakeholders a

For instance, 87 companies, such as AB Inbev, General Motors, and Wal-Mart Stores have joined the RE100 and made a commitment to purchase 100 percent RE.[16] In addition, 65 companies have signed onto the World Resources Institute's ("WRI") corporate energy buyers' principles. Further, 94 companies have become members of the business renewables center ("BRC") up from 36 in January 2016.[17] And, some electric utilities, including at least one in the MISO footprint (Xcel Energy in Minnesota), are now offering green tariff offerings to large and resideoar E M 0 Td ( )e9h 9.ur (o t)8,h 9.ur (o 0,)8

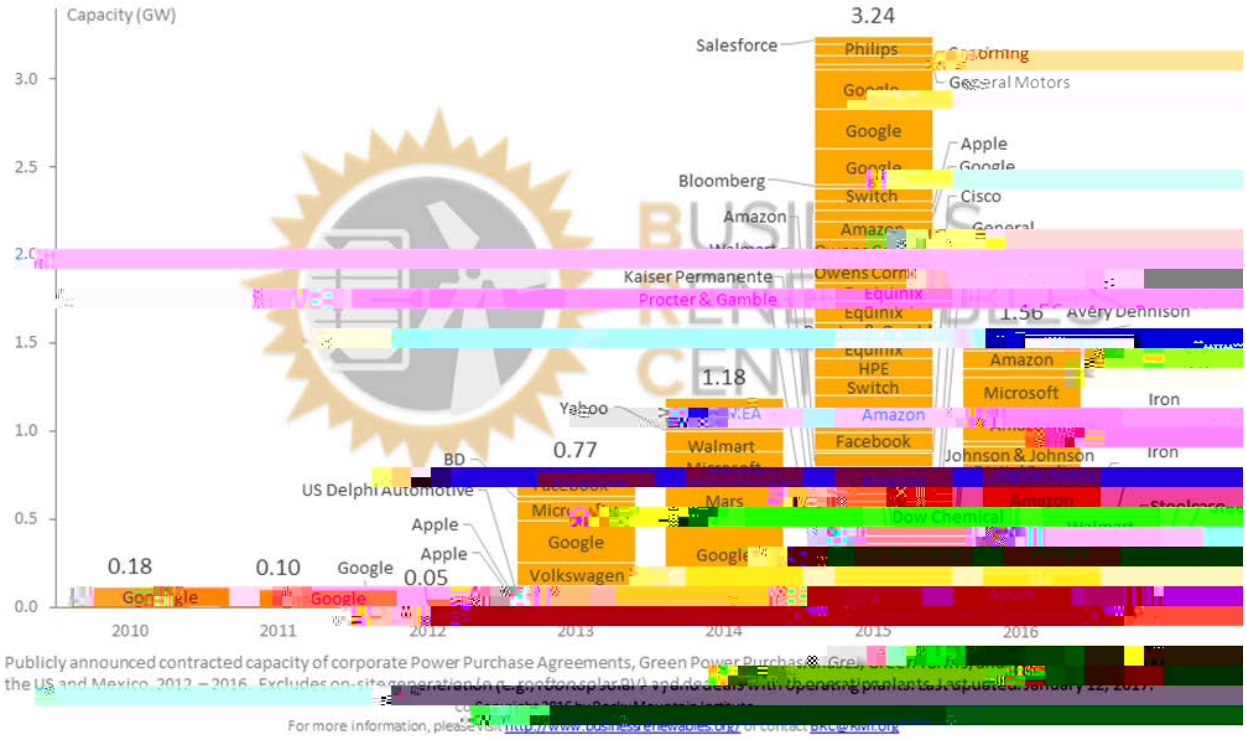

Figure 25: Corporate Off-site renewable energy purchases (2010-2016)
Source: Rocky Mountain Institute, and Invenergy.

c. Movement from policy to markets

Participants at the MISO 2033 event recognized the important role that public policy has played in the development of RE capacity over the past decade. But there was some consensus at the event that future RE development would be conditioned much more by market forces rather than mandates and subsidies. This makes sense for several reasons.

First, as shown earlier in Figure 22, most states have adopted an RPS. Over 75 percent of all U.S. electric retail sales are in states that have some form of RPS or RE goal. At this point, the states that have not adopted an RPS, likely never will, and the possibilities for adopting a national RPS are very small given past unsuccessful attempts.

Thus, from a mandate perspective, the only way RE can grow will be simply through increasing existing state RPS requirements

Second, outside of an RPS, the other predominant means of stimulating RE development has been through tax and subsidy/rebate policies. However, many state governmental agencies, and even the federal government, have started to appreciate the expensiveness of these forms of support. The American Recovery and Reinvestment Act ("ARRA") of 2009, for instance, spent as much as $16.8 billion on a variety of different forms of RE support from tax breaks, to low-interest loans, to other forms of loan guarantees.[18] These programs, however, are mostly one-time in nature (to address the recession) and have been discontinued. The ability to continue funding RE, at the state and federal level, given public budgeting and deficit concerns, falls each year and the likelihood of any new expanded public funding support for new RE development, particularly in a fashion comparable to ARRA and prior state-supported levels, is exceptionally low.

Market forces are already part of RE development and will continue to be important on a forward going basis. Increased RE development appears to have led to increased RE manufacturing development, which in turn, has driven down the costs of a variety of RE technologies, particularly solar and wind. Further, global competition, particularly from Asia, h</MCID 9 >>kt4 (f)2 (r)-3bs8WWWWWWW7 st deficn4 (t)2c9 (i)-20 (i)-14a(f)22 (or)-14 t4 (t)

through 2016. Installation costs per unit of capacity, for instance, have fallen by as much as 26.2 percent over this time.

Figure 26: Terrestrial Wind Generation Installed Capital Costs (2010-2016)

Note: 2012 estimated from NREL information by interpol6u54 (18u2)20 (r[04 T1 and15.73(e:)-15.7 (2012 es)15.8

d.

7. Solid fuel resources are challenged, but not going away

-14 Tf(uu)1-5-14 Tc 4 Ta (,)nt(uu)1 (-14 Ty 4 T (-14 Tow 26)1eea-)2 ()- (,)t(u)

a. Coal and nuclear1 (o)-5 Re[8d832t 8d832n(n)15 (o)1(r)13 (ces a5 (o.12 (ear)13 cd [(C

future, those MISO fuel mix shares are anticipated to be at only slightly lower levels that today, falling to 21.5 percent and 7.6 percent for coal and nuclear, respectively.

Figure 27: MISO Generation Fuel Mix (2010, 2016 and 2020)
Note: Percentages may not total to 100 due to rounding. a

First, solid fuel resources provide MISO with important fuel diversity benefits that may become important in a world that becomes heavily dominated by natural gas. While there are large scale and abundant natural gas resources, having an additional resource base from which to generate electricity can provide benefits in times of deliverability and

Figure 29: Trends in Installed Solar Generation Costs (2010-2017)
Source: Fu, Ran et. al. (September 2017), U.S. Solar Photovoltaic System Cost Benchmark: Q1 2017,

Table 8: MISO Solar Capacity (2012-2016)

Source: U.S. Energy Information Administration.

Table 9 provides similar information on solar installations but is limited to just distributed, behind-the-meter solar installations that are net metered. The table shows that on average, MISO states collectively only account for 2.2 percent of all U.S. solar NEM installations. Iowa, Mississippi and Missouri however, have seen considerable percentage growth in solar NEM installations between 2012 and 2016 at 2,439 percent, 1,455 percent and 686 percent, respectively.

development across all segment types: residential; commercial; and utility (grid-connected).

Figure 30: Forecast U.S. Solar Capacity by Market Segment (2015-

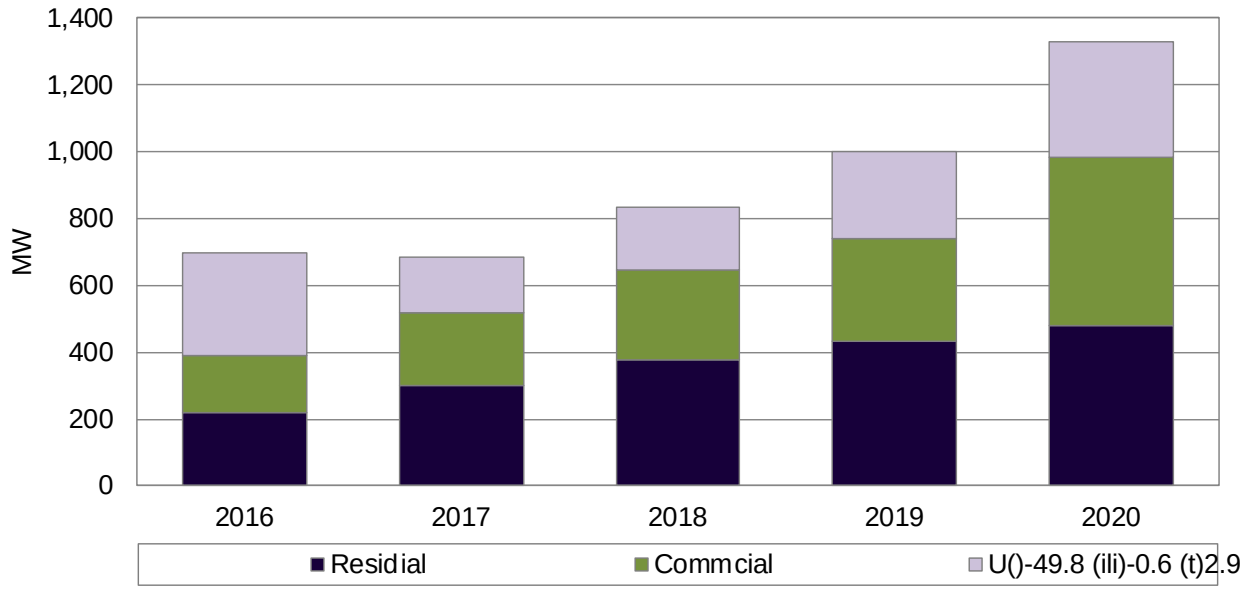

Figure 31: MISO-Based Projection, Solar Capacity by Market Segment (2016-2020)
Source: Solar Energy Industries Association, Author's construct.

Assuming MISO follows national trends, it could see solar capacity growth move from current moderate levels of capacity development toward a level that requires special transmission planning attention. Region-wide, MISO could see as much as 3,846 MW of new solar capacity by 2020, with 1,589 MW being associated with residential installations, 1,300 MW being associated commercial installations, and 957 MW being allocated to grid-scale projects.

One potential test of the projection outlined above would be to simply evaluate the solar installations that are already in the MISO interconnection queue which, as shown in Table 10, are considerable. As of year-end 2017, the MISO interconnection queue has as much as 14,025 MW of capacity requesting interconnection. Most of that capacity (86 percent) is anticipated to be on-line by 2020, at least for the capacity that provided commercial operation date information. Likewise, the average capacity of those proposed facilities seeking interconnection is 122 MW.

Table 10: MISO Solar Interconnection Requests

Source: MISO Interconnection Queue.

c. Other considerations

While policy, incentives, and decreasing costs are important in stimulating solar development, participants at the MISO 2033 event clearly recognized that a large part of this interest, particularly for behind the meter installations, is being motivated by customers' desire to control their own electricity decisions. This is particularly true for residential customers taking advantage of state NEM programs.

However, NEM is not without its share of controversy, motivated in large part by the considerable increase in behind-the-meter solar installations and capacities. Over the past several years, many states have begun to re-assess their NEM policies and retail rate structures in response to rapid behind-the-meter generation growth and the concerns this growth has created regarding cross-subsidization and lost base revenues. One of the particularly contentious issues surrounding these NEM tariff and rule modifications has been on how to value behind-the-meter generation (primarily solar generation) that is put to the distribution grid.

Historically, most NEM generation has been valued at full retail rates primarily due to what was considered administrative ease in an era when NEM installations were few

and far between. Today, what started as administrative ease is now seen by many as a regulatory burden since policies valuing NEM at full retail rates effectively reimburse a generation-only product at a vertically-integrated utility cost. This has led some state regulators to the conclusion that a different set of price signals needs to be utilized to reimburse this NEM generation. These price signals need to be more accurate and consistent with the opportunity cost of the behind-the-meter generation being put to the grid.

Participants at the MISO 2033 event noted that this valuation challenge could be ameliorated, at least in part, through the MISO longer run planning process and through continued development of institutions and markets that can send signals about the value of a variety of electricity products being offered across a variety of geographical areas, for various durations, by a differing set of market participants. Further, MISO's planning process can reveal the "upstream" implications of "downstream" solar installations for regulatory purposes. This includes providing education and information about the benefits and cost of distributed generation on the transmission system and longer-term transmission infrastructure investment.

9. Customers Issues: Usage, Prices and Empowerment

a. Customer issues

Customer interests in greener and more advanced technologies are growing in importance. However, the MISO 2033 event clearly underscored the fact that, despite an expanding set of customer interests into issues like renewables and resiliency, the top three customer concerns continue to be the "old-fashioned" ones of cost, reliability and market transparency. The MISO 2033 event included a roundtable discussion focused

Figure 32: U.S. Estimated Electricity Rates (Retail Revenue cents per kWh)
Source: U.S. Energy Information Administration.

The competitiveness of the region's electricity rates, however, should not over shadow the fact that many consumer groups, particularly those closely engaged in the ratemaking process, have expressed concerns about the ever-increasing utility transmission investments, many of which reflect investments or allocation of investments, associated with MISO-related upgrades. Table 11 for instance, shows the changes in net

efficiency projects that have a voltage rating of 345 kV and above, are typically based on a split of 80 percent to local resource zones (based on benefit of the project), and 20 percent to the remaining loads flowing throughout the footprint.

Transmission upgrades associated with individual generator interconnection requests are primarily paid for by the interconnecting generator, except for investments made on projects of voltage ratings of 345 kV and larger. The costs of these larger transmission infrastructure projects are allocated 90 percent to the interconnecting generator, with the balance (10 percent) allocated to the remaining loads in the system.

MISO also makes transmission infrastructure investments that are referred to as "multi-

The “socialized” nature of certain types of transmission infrastructure investments also raises several public policy issues relative to transmission siting and local economic development. For instance, some state siting statutes require that the adjudicating authorit

transmission infrastructure planning process; and (b) educating stakeholders about the various constraints, options and alternatives associated with various transmission infrastructure options. What became clear in this discussion is that part of this education process should including making clear, to a wide range of stakeholders, the results of planning and post-development cost-benefits ratios regarding large and multi-regional (multi-value) projects.

d. Education and Communication regarding Transmission Infrastructure Benefits

Retail customers, and entities representing these customers such as consumer counsels, trade, and user associations, have been increasingly concerned about the rapid increase in transmission-related costs and how those are entering retail rates. What often goes unnoticed however, is that these increases in transmission investment represent a "cost" which must be compared to the "benefit" of securing more efficient electricity from wholesale power. While the transmission investment "cost" is often seen by many consumers, the wholesale benefits and how those are translated into lower bills, is often not as easily identified.

Figure 33 summarizes the "all-in price" of wholesale electricity that is calculated as the load-weighted average real-time energy price plus capacity, ancillary services, and real-time uplift cost per MWh of real-time load in the region. Figure 33 also charts this all-in price against natural gas prices as measured at the Chicago Citygate. As is expected, electricity prices in the MISO footprint are heavily correlated with wholesale natural gas prices so as natural gas prices have fallen, so too have wholesale electricity prices. However, while 2015 prices have fallen relative to 2014 prices, 2016 all-in

wholesale prices are up somewhat given increases primary in the cost of capacity over the better part of last year.

Figure 33: MISO "All-In" Wholesale Electricity Price vs. Natural Gas Price
Source: Potomac Economics, 2016 State of the Market Report for the MISO Electricity Markets.

While Figure 33 presents a generally positive outcome for MISO customers (i.e., generally lower wholesale rates) there are other benefits, such as a reduction in price volatility, that should be considered as well. Figure 34, for instance, presents a price duration curve for 2014 through 2016. This curve shows the percentage of time in which wholesale prices (presented in terms of locational marginal prices, or "LMPs"), are above certain fixed levels; in this instance, about $200 per MWh, above $1(ns)4 (t)2 (anc)4 (e)20 (,)2 0 Td

Figure 34: MISO Real-Time Energy Price-Duration Curve (2014-2016)
Source: 2016 State of the Market Report for the MISO Electricity Markets, Analytic Appendix

The improvement in MISO wholesale price volatility compares well to other similar RTOs. Figure 35, for instance, presents the fifteen-

Figure 35: Comparison of RTO Pricing Volatility
(2015-2016, Fifteen-Minute Real-Time Price Variation)

Source: Potomac Economics,

Transfer constraints between neighboring markets adjacent to MISO also fell considerably from 2014 to 2015, and again from 2015 to 2016. Part of this price decrease can be attributed to a recent (January 2016) agreement between MISO and SPP that allowed MISO to capture substantial dispatch savings in balancing across the two systems[21]. While the value of congestion was slightly up in 2016 (4.3 percent), it was still down considerably from 2014 levels (42 percent reduction). Overall congestion revenues were lower in 2016 and there was a surplus in firm transmission rights ("FTRs") in 2016

transmission capacity.[22] The analysis shows that additional transmission in the MISO Central region would have provided approximately $90.8 million in benefits in 2016. Additional transmission in the remainder of MISO North and in MISO South would have provided approximately $33 and $31.6 million in benefits, respectively.

Figure 38

to 3.0 times the original costs associated with transmission infrastructure investments in each of these zones across the various MISO planning processes.

Figure 39: Estimated Transmission Investment Cost-Benefit Ratios (MTEP11, MTEP14, and MTEP17)
Source: MTEP17, MISO Transmission Expansion Plan.

e. Customer Empowerment and Choice

Competition and competitive markets are important across the MISO footprint and while most of the MISO member states do not allow for retail choice, this has not diminished the interest of some customer groups, primarily large industrial customers, for securing their own power supplies from either themselves or from parties other than LSEs. Industrial customers are often diverse and do have many competitive alternatives. Many of these industrial customers, particularly those in the MISO South region, have been securing their own competitive supplies of natural gas, directly from a variety of suppliers, often directly off the interstate natural gas transmission system, for decades.

There are a few ways in which industrial customers could alter how they secure electricity. Most industrial customers, for instance, are also large producers of electricity themselves. MISO has over 65 generation facilities within its footprint that are considered industrial cogeneration facilities. A map of those facilities and their in-state capacity (for 2016) is provided in Figure 40. As of 2016, there were over 9,418 MW of active industrial cogeneration in the MISO footprint, accounting for 60.4 percent of the total active generation capacity in the region (the states in which MISO is present).

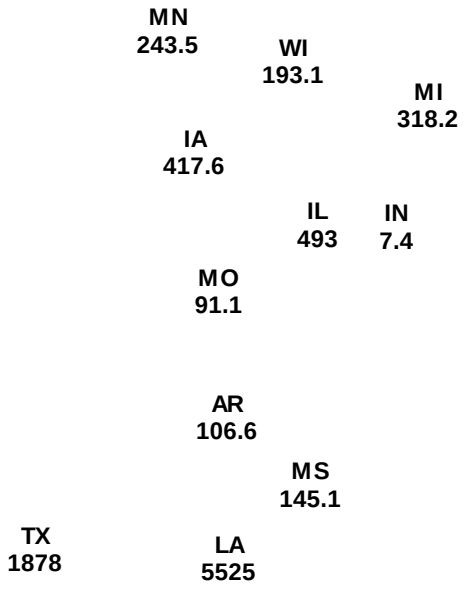

Figure 40: 2016 MISO Industrial Cogeneration/On-site Generation (MWh)
Source: U.S. Energy Information Administration.

One important option that could be available to industrial generators could incude what can be referred to as “affiliate wheeling:” allowing an industrial generator to use the MISO transmission assets (including those owned by its host utility) to “wheel” excess

power from one location to another location, provided that the plants at the two locations are part of the same company. So, as an example, an affiliate wheeling transaction would allow a company like the Dow Chemical Company to contract to transport electricity across the transmission system to its affiliate at another location either within, or even potentially across a state line. The ability to engage in this activity would be strictly limited to affiliates and the amount of on-site generated electricity at affiliate locations. Figure 41 shows that, at least based upon recent trends, there has been steady and what appears to be relatively reliable trend of on-site industrial generation (at least from an aggregate perspective) across the region over the past decade.

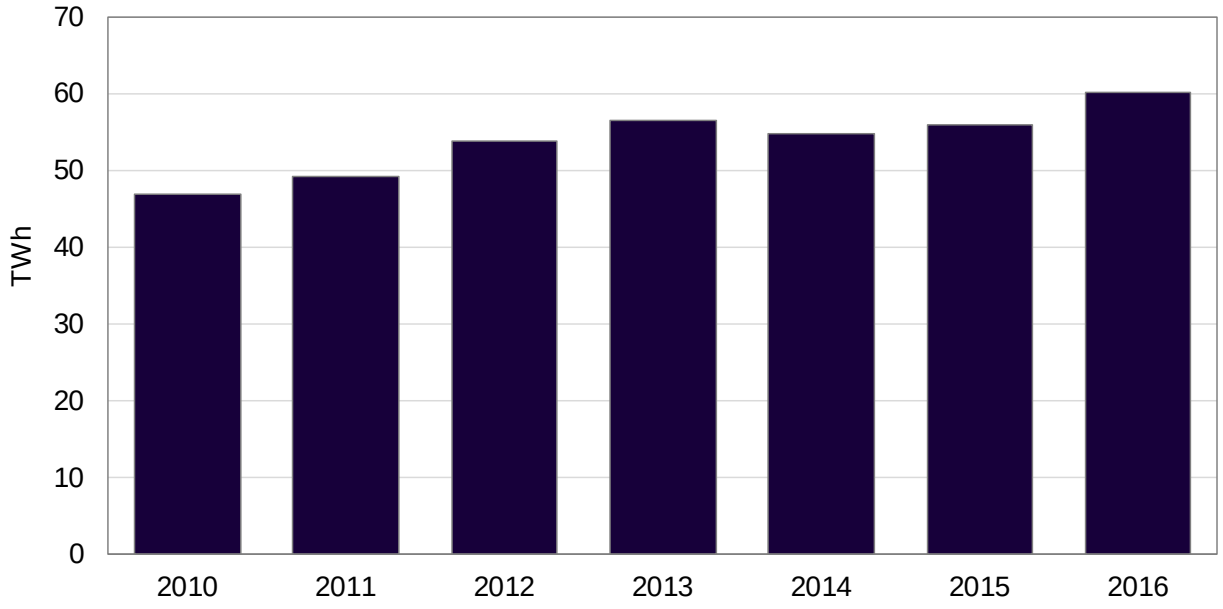

Figure 41: MISO Industrial Cogeneration/On-site Generation (2010-2016)
Source: U.S. Energy Information Administration.

The ability to facilitate some limited amount of industrial choice is often tied to economic development, particularly over the past several years which has seen a "renaissance" in industrial project development announcements, particularly in the MISO South region. Small differences in electricity rates, in theory, can potentially influence

siting location decisions for large industrial users. Thus, having the ability to offer some form of limited retail industrial choice, such as affiliate wheeling, or some other restricted process, could represent an important tool for economic developers.

Ultimately, the issue of limited retail choice for industrial customers is a state legislative and/or regulatory issue. For MISO, these considerations are important because they underscore the increasing desire for customers to seek greater levels of empowerment, either through the use of technology or policy, or both. This pressure for greater levels of choice and empowerment will influence the long-run transmission infrastructure planning process including the location, scope, and nature of future transmission investment projects. This type of variation plays to concerns regulators expressed, which were discussed earlier, about potential unanticipated shocks to the system which could lead to various projects becoming "bridges to nowhere" or "white elephants." Ultimately, this is an issue for which MISO needs to be mindful, but one that clearly will have to percolate up from the state regulatory process.

10. Conclusions

The U.S. bulk power system arose over the past century to harness the economies of scale and efficiencies associated with the large-scale movement of alternating current ("AC") over long distances. The vision of Westinghouse, Tesla, and Stanley trumped that of Edison in winning the war of the currents and the standardization of the industry we have today. The links between various vertically integrated utilities and the regions in which they operate were focused primarily on developing a system that could be tapped upon for reliability-related purposes: to share electricity during extreme weather events, outages and to manage other unforeseen crises. This system, and most importantly its

component transmission infrastructure, was not developed to facilitate a high level of commerce at a regional, and particularly a sub-region basis.

Order 888 was issued by the FERC over two decades ago and established a framework and vision for a new industry organization, one that was less fragmented and balkanized and more integrated, diversified, seamless and efficient. This Order also envisioned a system that would facilitate the development of markets and an expansive set of physical and financial transactions that would lead to better resource optimization and efficiencies. At the time, RTOs were established as the focal institution that would facilitate and maintain this dramatic market transformation on both a commercial and physical basis.

Infrastructure development was at the heart of the industry transformation started by Order 888 since, at that time, the bulk power system of the past was clearly neither adequate nor sufficient to sustain any extensive degree of commercial activity. While a considerable amount of infrastructure development has been completed over the past two decades, there is considerably more work that needs to be done to reach this vision.

A consistent public policy theme in U.S. politics is developing and rebuilding infrastructure. This theme dates back to the early days of the Republic and continues even today as engineers, economists, and other pundits lament the current status of U.S. infrastructure and the need to upgrade this infrastructure to meet modern needs. Boldness and vision are often cited as the standard prerequisites for infrastructure development success. The electric power industry is not immune to these calls, and the MISO 2035 echoed many of the same themes of urgency and necessity for transmission

infrastructure development that are echoed in discussions about upgrading roads, highways, schools, hospitals, transportation, communications and water systems.

The voices of inertia and the status quo are often heralded as the main barriers to boldness and vision and often the only factor that unfortunately seems to break the logjam between these two opposing forces are large-scale infrastructure failures and catastrophes. The bulk power transmission system is no stranger to this phenomenon as witnessed by numerous large-scale power outages that have arisen in the industry dating back to the infamous northeastern black out of 1965. Clearly, this is no way to manage, much less plan for a highly complicated set of critical energy infrastructure.

Transmission Infrastructure development is no easier today, in 2018, than it was in decades past, and is now confounded by dramatic changes in not only technology, but customer usage and preferences. Technology, in particular, seems to be placing some of the more significant and near-term challenges on transmission system investments. This should come as no surprise since technology, by its very nature, has a disruptive impact on society and particularly market institutions. What is unique about today's technological innovations, however, is that the scale-orientation of these new technologies are primarily distributed and decentralized in nature; a characteristic that strikes at the very heart of over a century's worth of power industry structural organization. Plus, it should come as no surprise that the financial consequences of getting these infrastructure investments all wrong, are even more prohibitive than in decades past.

However, as the MISO 2033 event found, large-scale bulk power system infrastructure investments, and smaller-scale distributed technologies do not have to be mutually exclusive. The value of the bulk power transmission system, while changing,

still rests its integrated nature. The integrated nature of the transmission system will

- Developing market design and market protocols that leverage physical transmission investments to develop framework that provides price signals and creates efficiency.
- Engaging stakeholders in the planning process to ensure adequate feedback on customer needs to ensure minimized costs and maximized value.
- Educating customers about the value proposition of these transmission infrastructure investments, their cost-benefit ratios on both a pre and post development basis.

Lastly, the discussion at the MISO 2033 event highlighted that transparency is one of the most powerful tools in executing a bold transmission infrastructure planning vision.